

This Page Is Inserted by IFW Operations
and is not a part of the Official Record

BEST AVAILABLE IMAGES

Defective images within this document are accurate representations of the original documents submitted by the applicant.

Defects in the images may include (but are not limited to):


- BLACK BORDERS
- TEXT CUT OFF AT TOP, BOTTOM OR SIDES
- FADED TEXT
- ILLEGIBLE TEXT
- SKEWED/SLANTED IMAGES
- COLORED PHOTOS
- BLACK OR VERY BLACK AND WHITE DARK PHOTOS
- GRAY SCALE DOCUMENTS

IMAGES ARE BEST AVAILABLE COPY.

**As rescanning documents *will not* correct images,
please do not report the images to the
Image Problems Mailbox.**




1A1



1A2

$\text{PFC/PC} = 0$

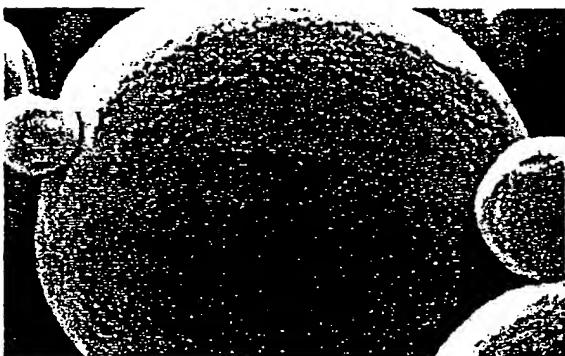

1B1



1B2

$\text{PFC/PC} = 1.1$



1C1




1C2

$\text{PFC/PC} = 2.2$

FIG. 1 (SHEET 1 OF 2)

09218213.122298

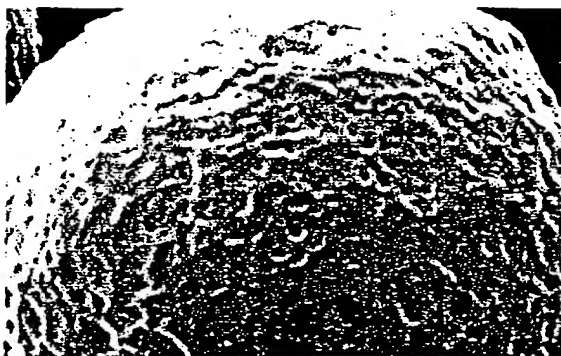


1D1




1D2

$PFC/PC = 4.8$

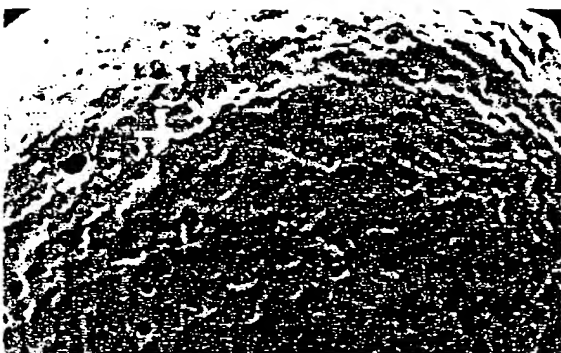


1E1

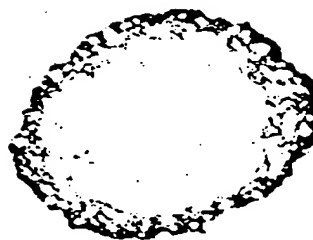

1E2

$PFC/PC = 18.8$

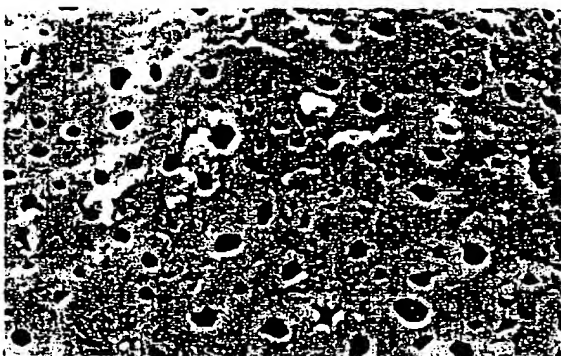

1F1



1F2

$PFC/PC = 44.7$

FIG. 1 (SHEET 2 OF 2)

09218213-122298

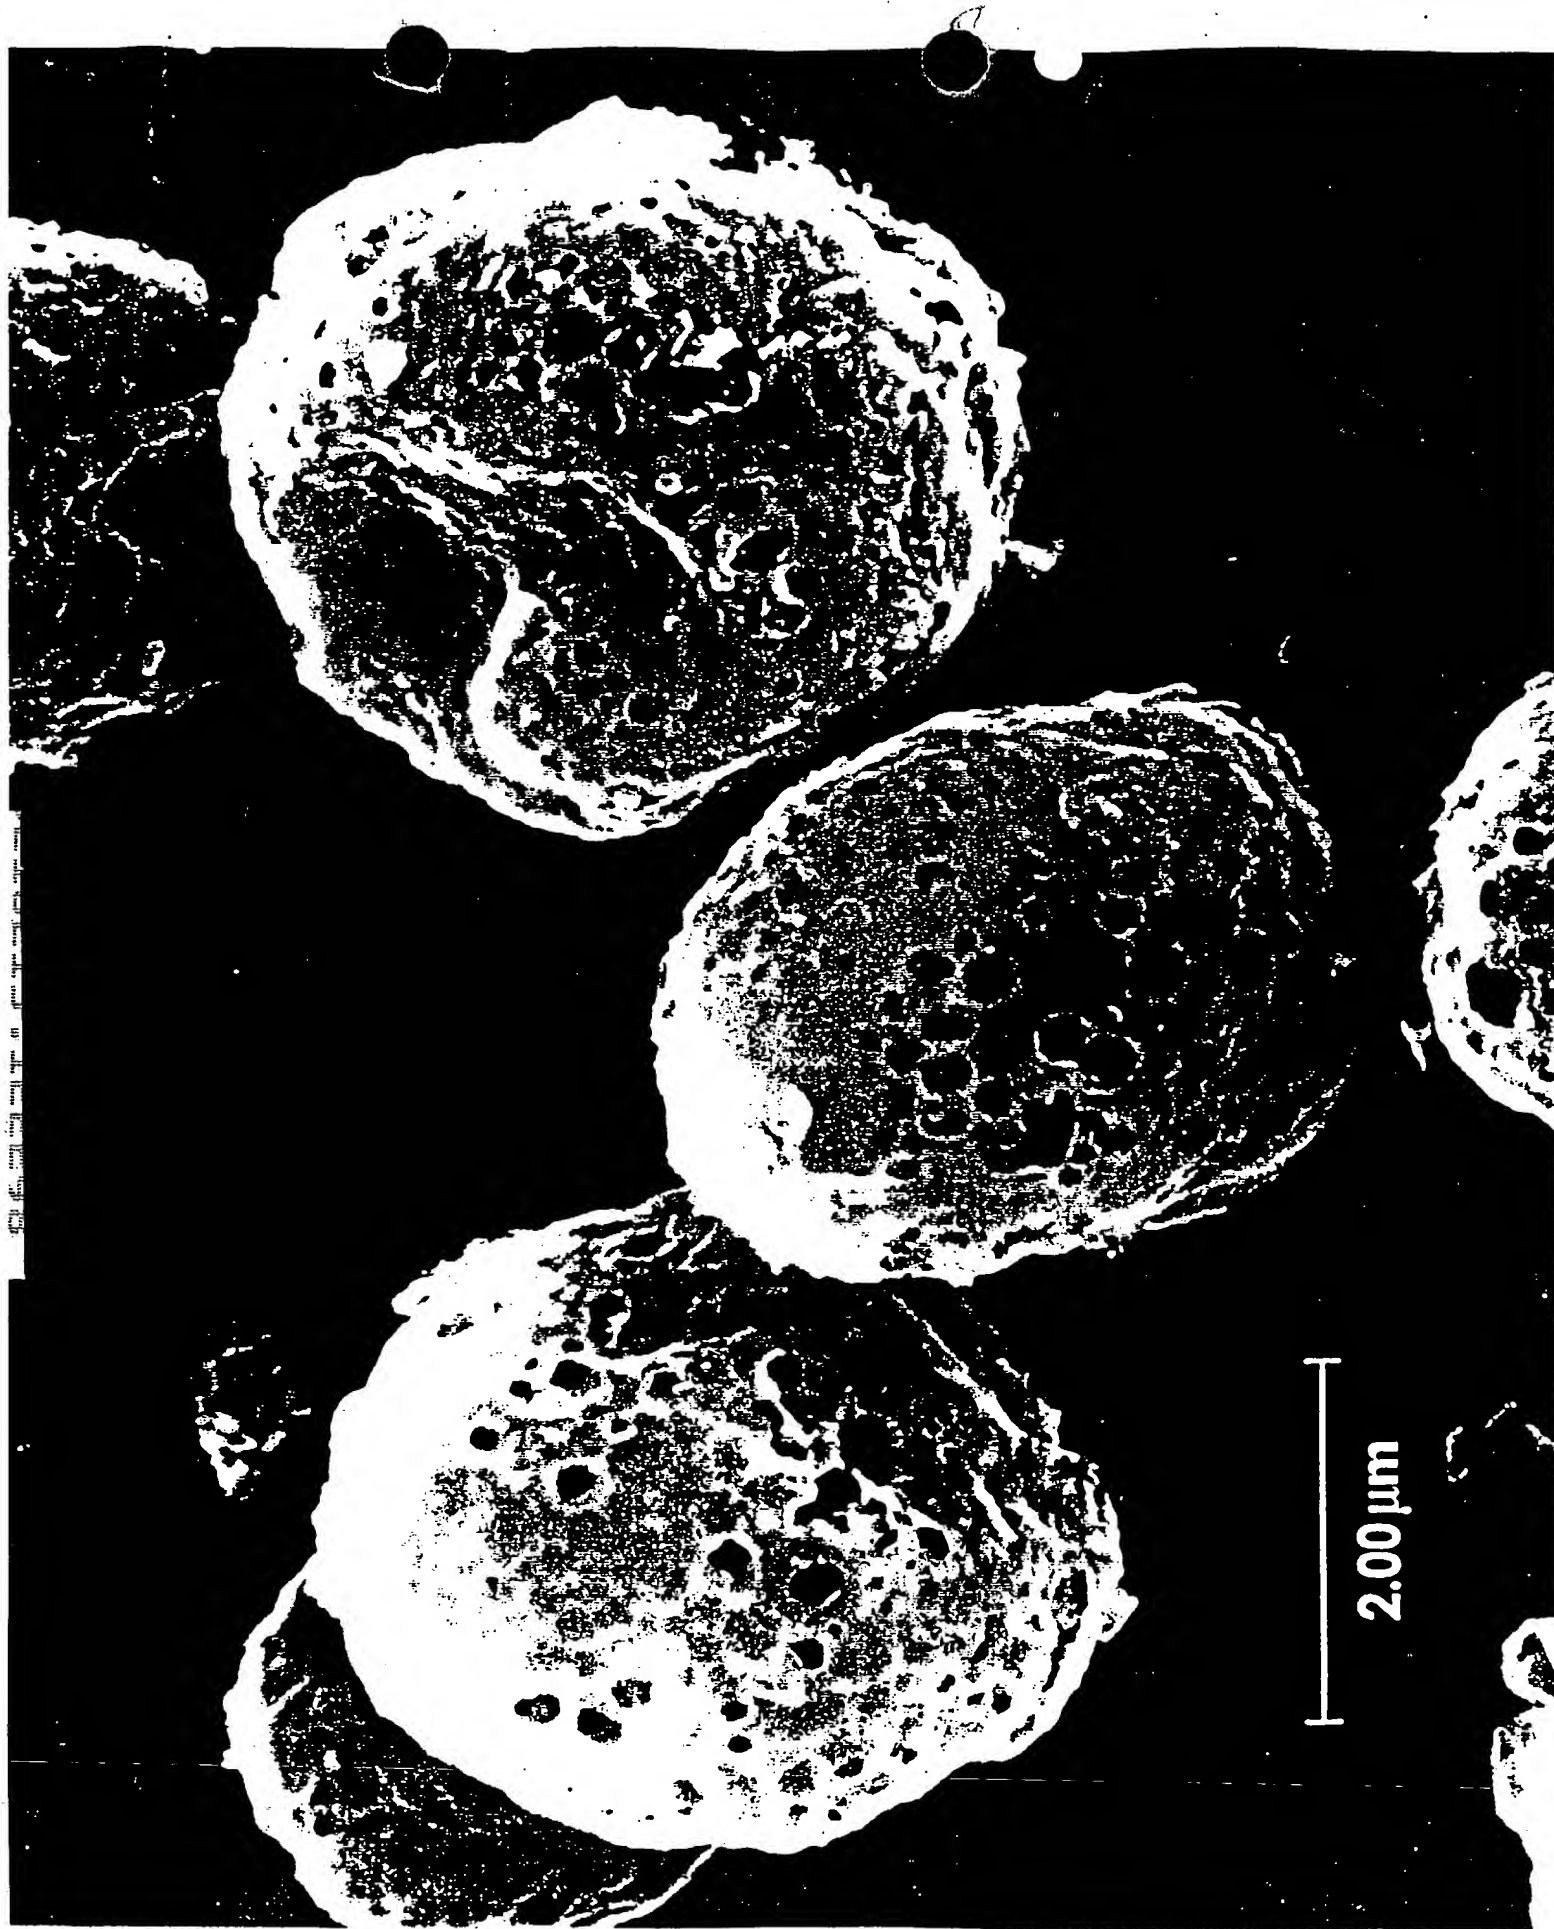


Figure 2

PulmoSpheresTM (cromolyn sodium)

Jet Nebulization versus MDI

PulmoSpheres (PFOE)[^]
 PulmoSpheres (HFA)^{*}
 (4 mg/ml, 10 ml)

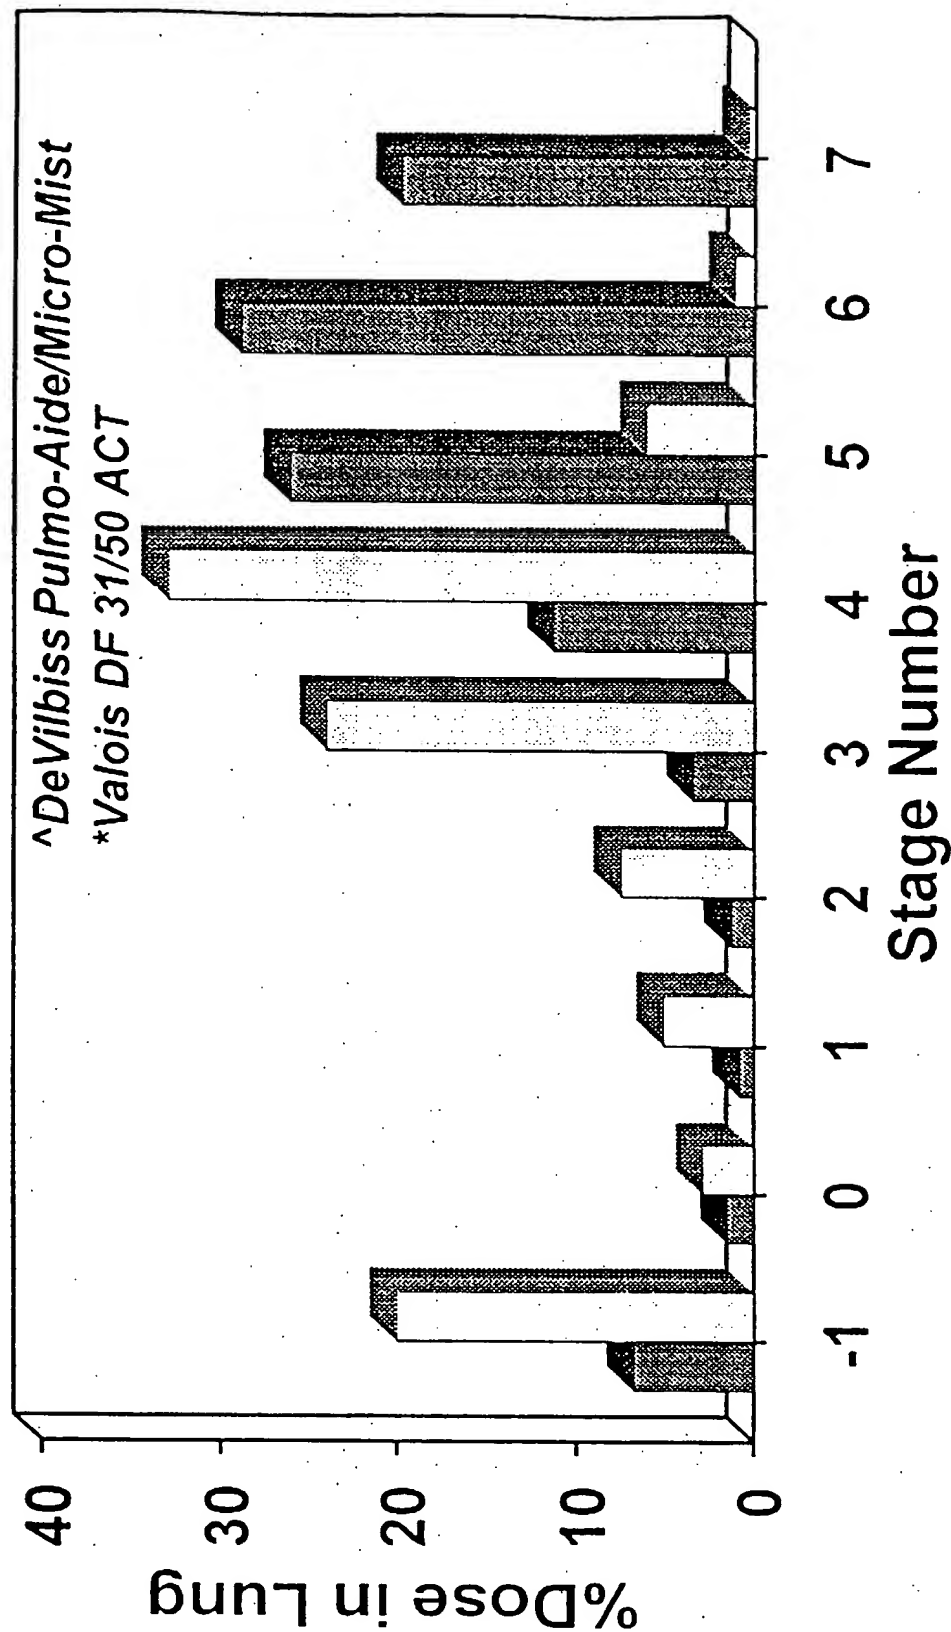


FIG. 3